

Implementation of the Large Combustion Plants Directive



2022 submissions – Preliminary analysis


European Environment Agency | 25.04.2023 | Energy Community – 25th Environmental Task Force meeting

Reporting of 2022 data


- Deadline: 31 March 2023
- All countries have submitted their data. Many thanks!

Country	Submission date
Montenegro	13/04/2023
Georgia	31/03/2023
Republic of Serbia	28/03/2023
Bosnia and Herzegovina	23/03/2023
Moldova	14/03/2023
North Macedonia	10/03/2023
Ukraine	09/03/2023
Kosovo	19/01/2023


Summary of reported data – All emissions

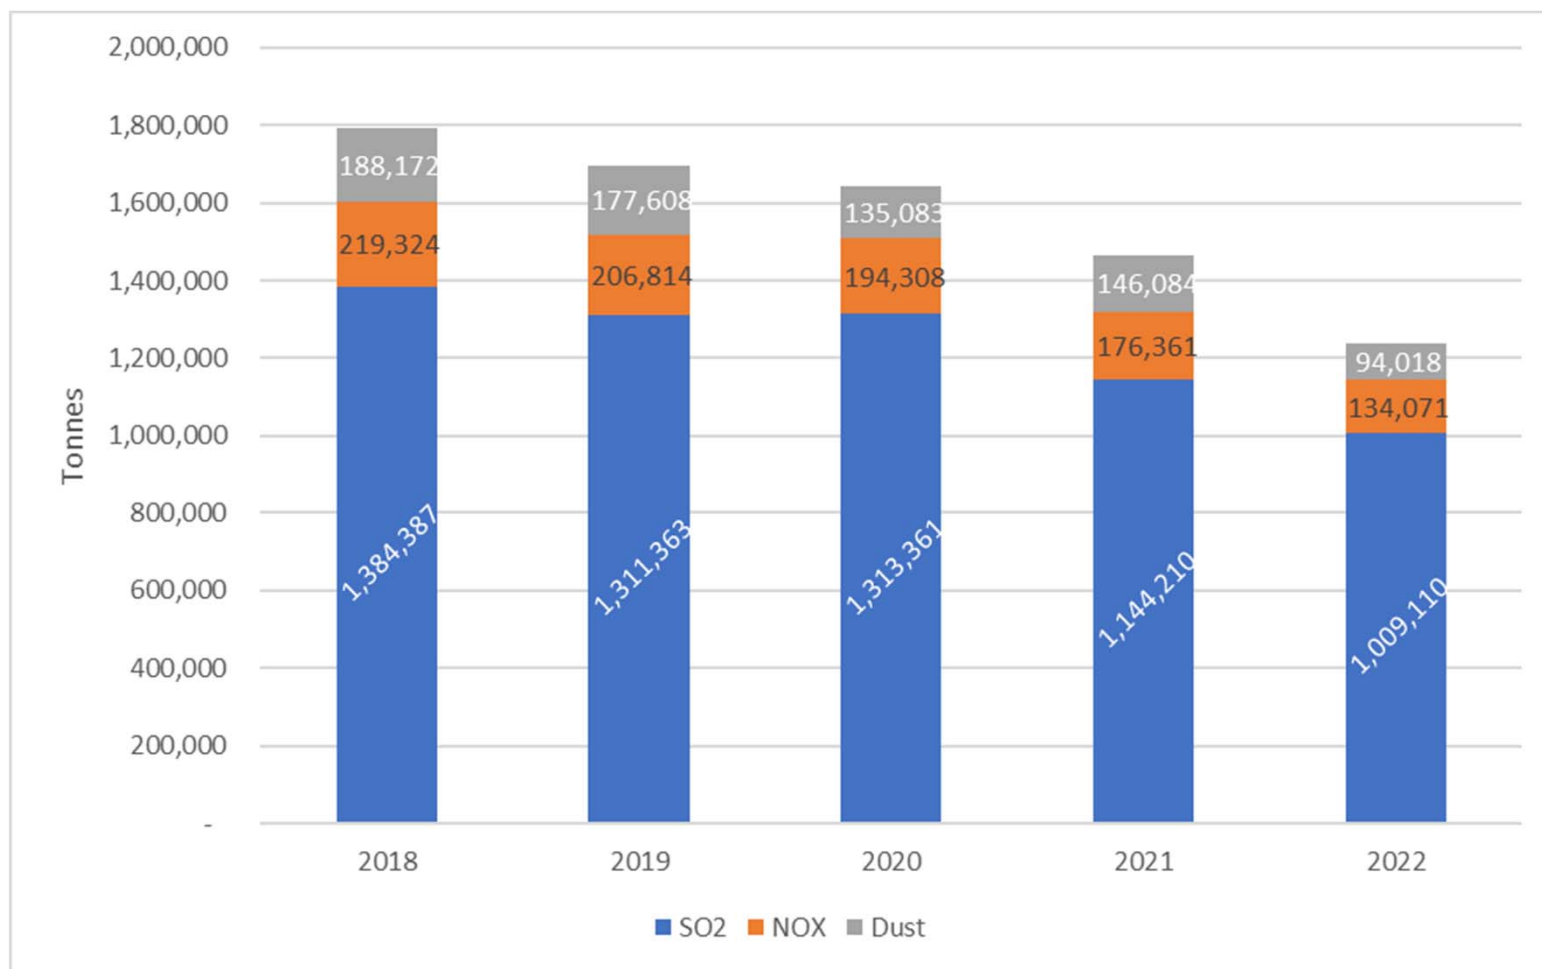


Summary of reported data – Overview per year (1)

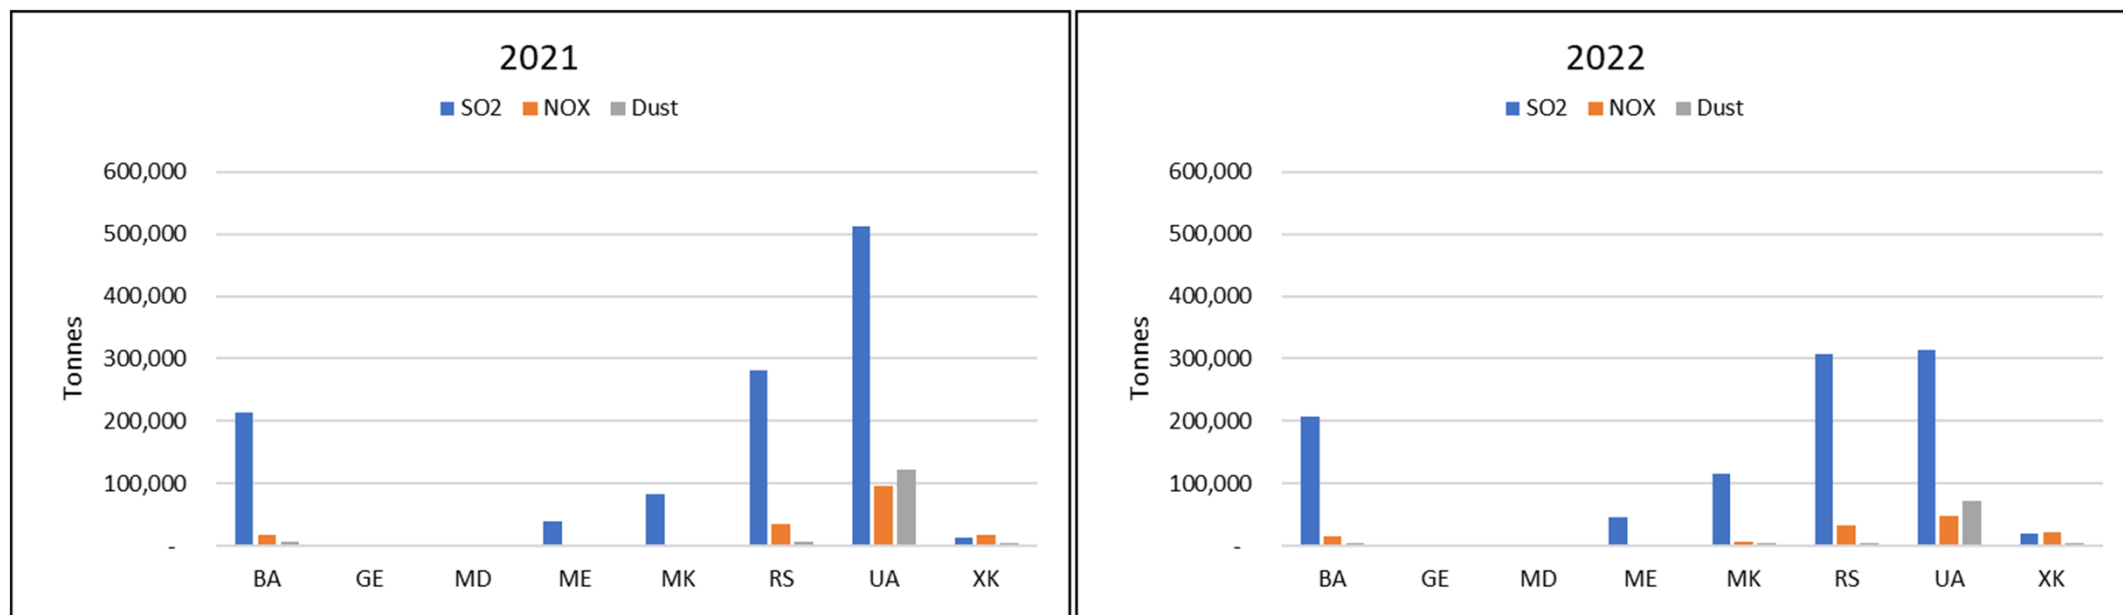

Summary of reported data – Overview per year (2)

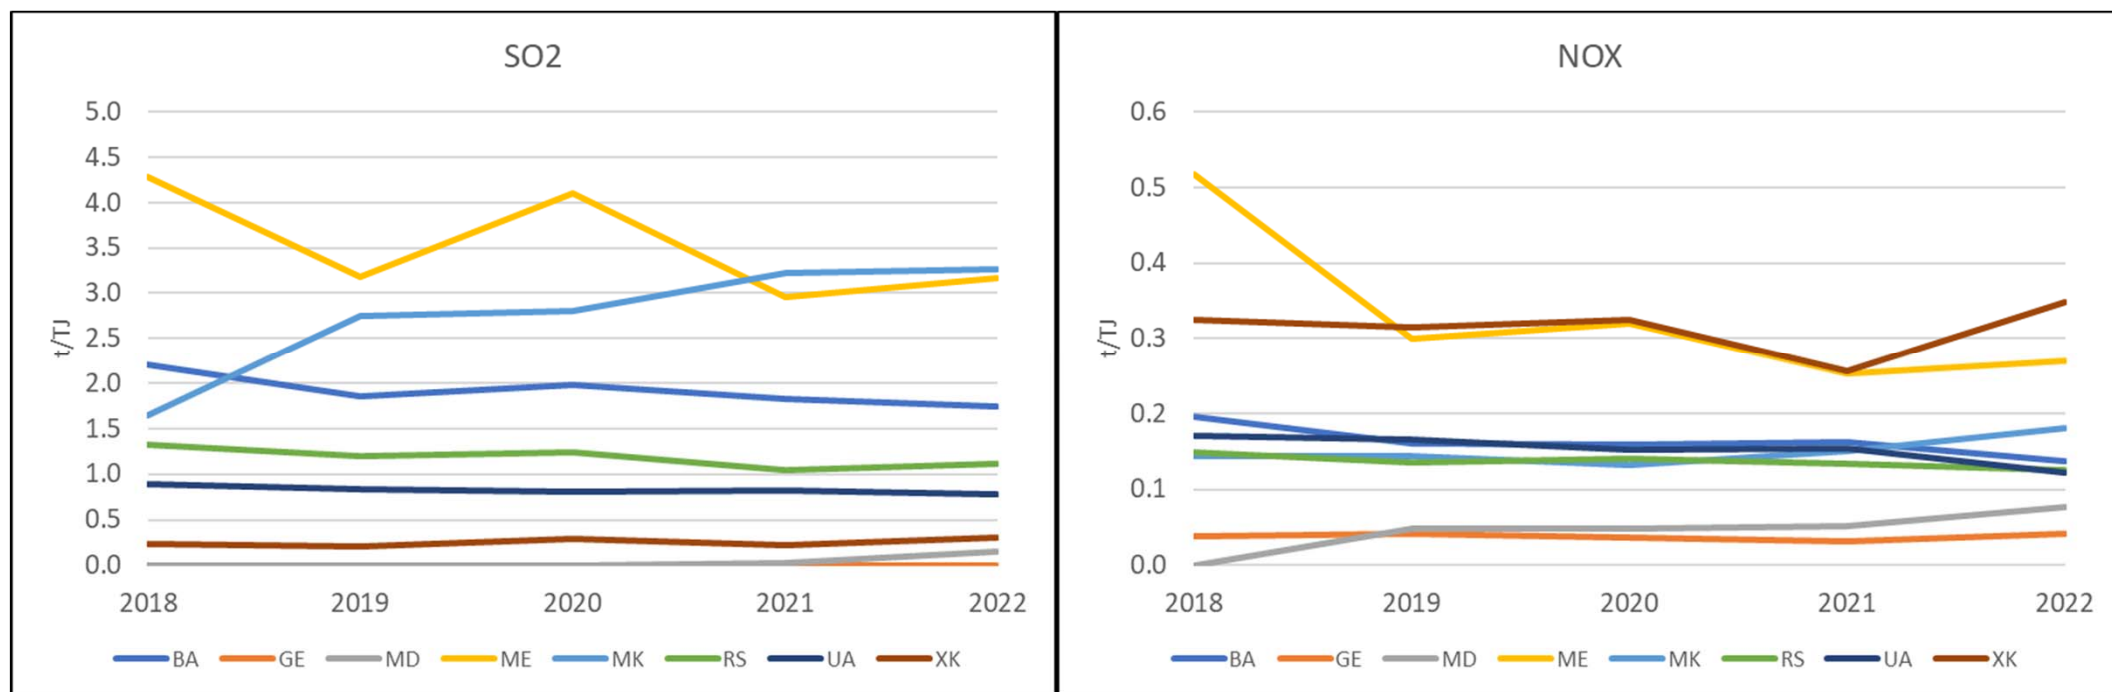


Summary of reported data – Overview per year (3)

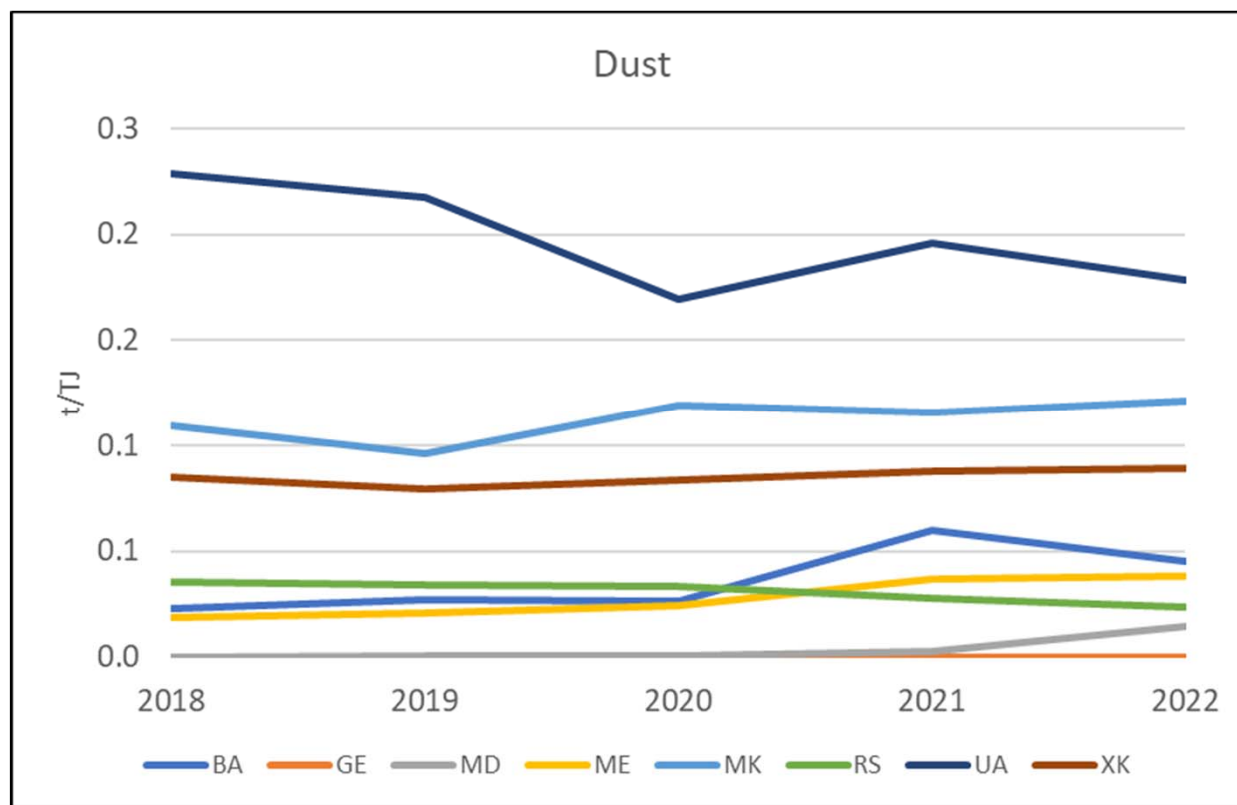


Opt-out – Bosnia and Herzegovina

- 3 plants – 20,000 h derogation (2018-2023)
- Kakanj-5 (22,058) and Tuzla-4 (23,892) are above the limit since 2022

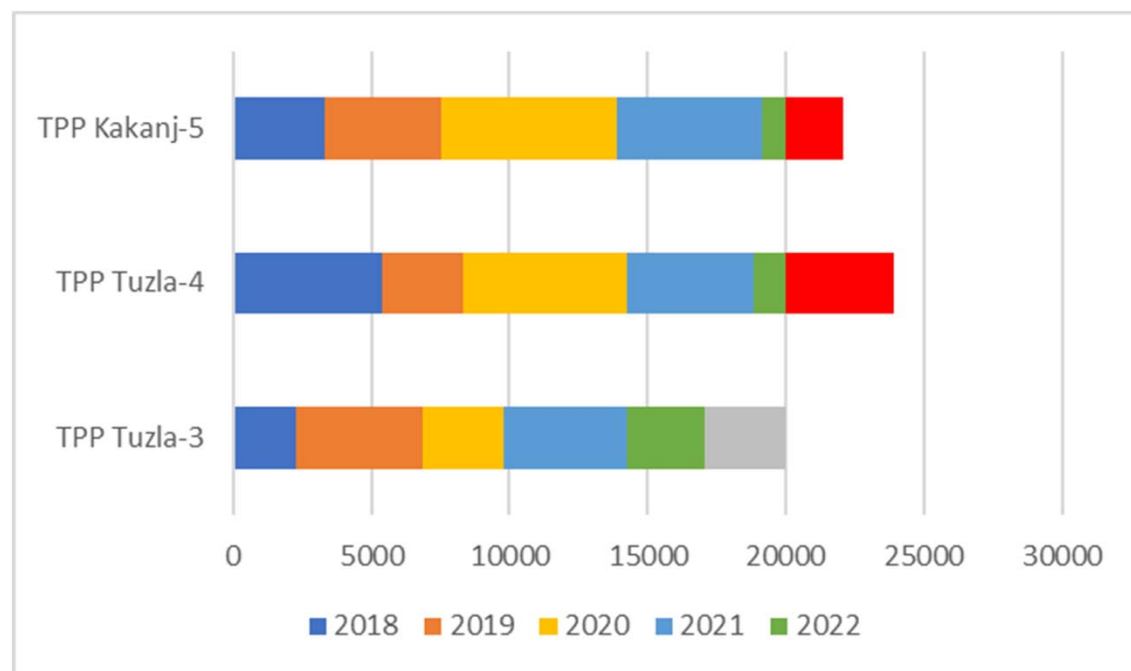


Opt-out – Montenegro

- 1 plant – 20,000 h derogation (2018-2023)
- During 2020, the plant went over the limit
- Currently >14,000 hours above the limit (34,412 hours)

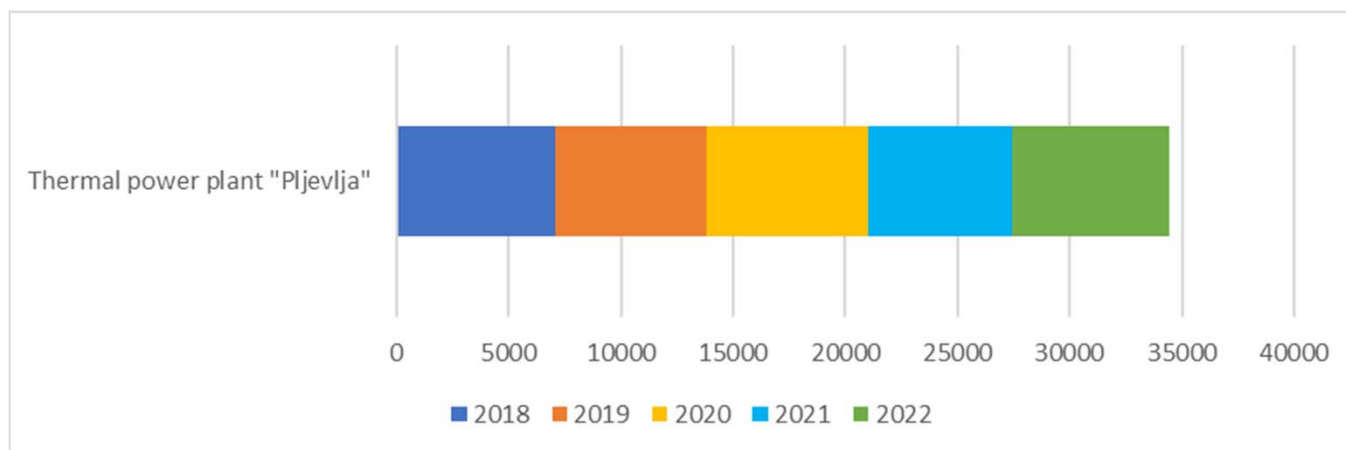


Opt-out – Montenegro

- 1 plant – 20,000 h derogation (2018-2023)
- During 2020, the plant went over the limit
- Currently >14,000 hours above the limit (34,412 hours)

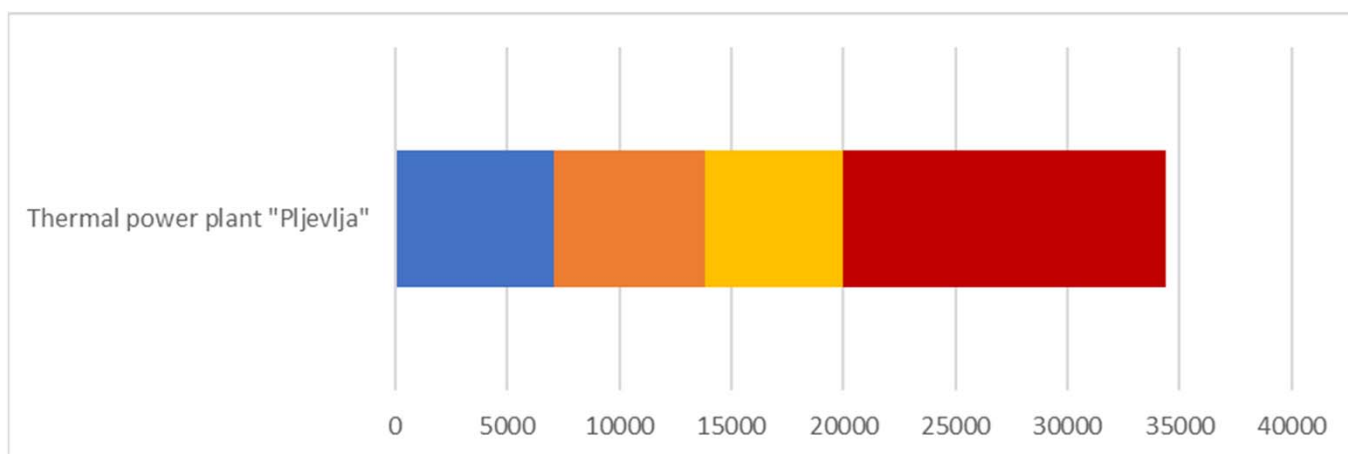

Opt-out – Serbia


- 4 plants – 20,000 h derogation (2018-2023)
- TE Morava went over the limit in 2022
- The other LCPs could go over the limit at the current usage rate

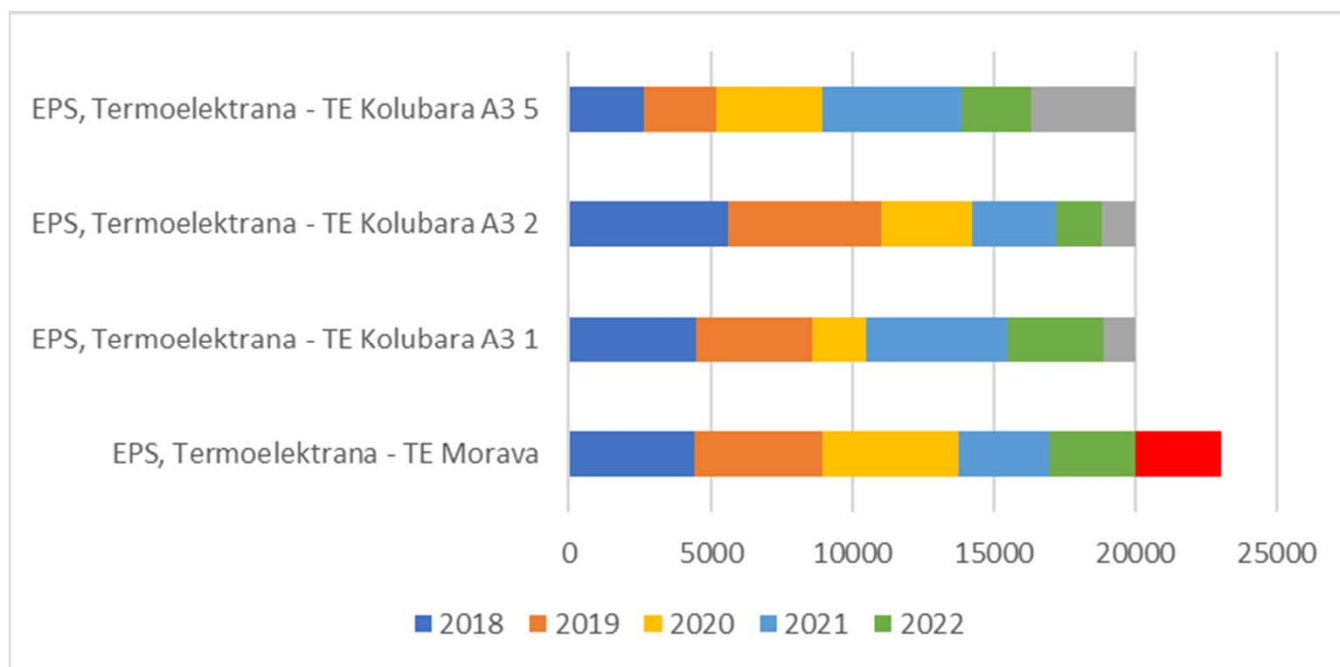

Opt-out – Ukraine (1)

- 19 plants – 20,000 h derogation (2018-2023)

- 1 decommissioned
- 9 were due to cease operations from 01/01/2022 (3 continued operating after that date)
- 1 plant reached 20,000h in 2021 (it has now gone over the limit). Another LCP in the same power plant has also reached the limit.

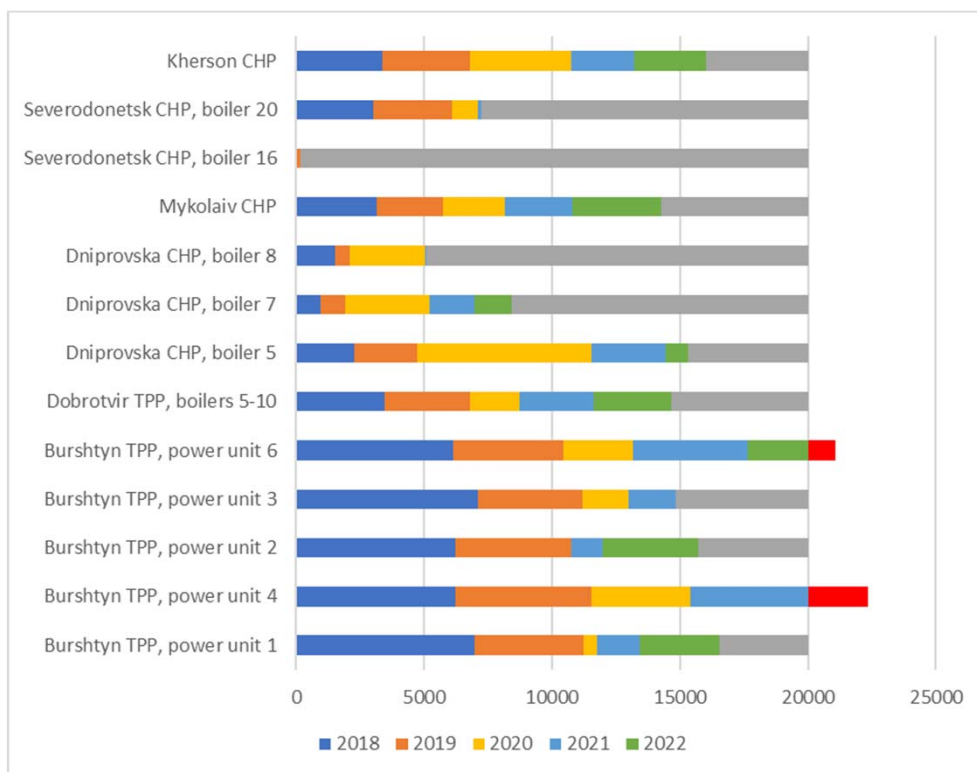

Opt-out – Ukraine (2)

- 59 plants – 40,000 h derogation (2018-2033)
 - Only 3 were used over 6 months during 2022
 - 10 plants have consumed half of the hours
 - 40,000h = Average of 2,500h per year (2018-2033)
 - 22 plants have made more than 12,500 hours (2,500hx5)
 - 1 plant has been decommissioned
 - For several plants there is no data available due to the current hostilities

Reminder

- Communicate changes in reporters to receive updates and communications
- EEA will contact reporters in due course for technical clarifications
- Resubmit corrections in CDR

Resources

- Help page: https://cdr.eionet.europa.eu/help/lcp_ener
– Official letter and templates
- EEA Contact point: Juan Calero
(juan.Calero@eea.europa.eu)